

CORRIGENDUM/ADDENDUM- 1

NIT No.: WAP/ENVT/H-3082/CSEZ/2022-23/30 Dt. 25.08.2022


Name of Work: SITC of ATS (Automatic Transfer Switch) and AMF relay (Auto Mains Failure) for automatic start and changeover of 125 KVA DG set in Administrative Building, CSEZ, Kakkanad

Sl. No	Pg. No.	As per Uploaded tender document	Revised as follows
1	Pg. No. 3	Last date & time of Procurement / download of tender Document. 12.09.2022 at 15:00 Hrs	Last date & time of Procurement / download of tender Document. 16.09.2022 at 15:00 Hrs
2	Pg.No.3	Last date & time for submission Bid. 12.09.2022 up to 15:30 hours	Last date & time for submission Bid. 16.09.2022 up to 15:30 hours
3	Pg No. 10	Bill of Quantities – Sl. No. 1 ATS approved make not mentioned	ATS approved makes are- Socomec and Asco
4	Pg No. 10	Bill of Quantities – Sl. No. 1 MCCB approved make not mentioned	MCCB approved makes are- L&T, ABB, Siemens and Schneider
5	Pg No. 10	Bill of Quantities – Sl. No. 1 Drawing is not attached	Drawing is attached

Sd/-

General Manager (SEZ)

WAPCOS Limited

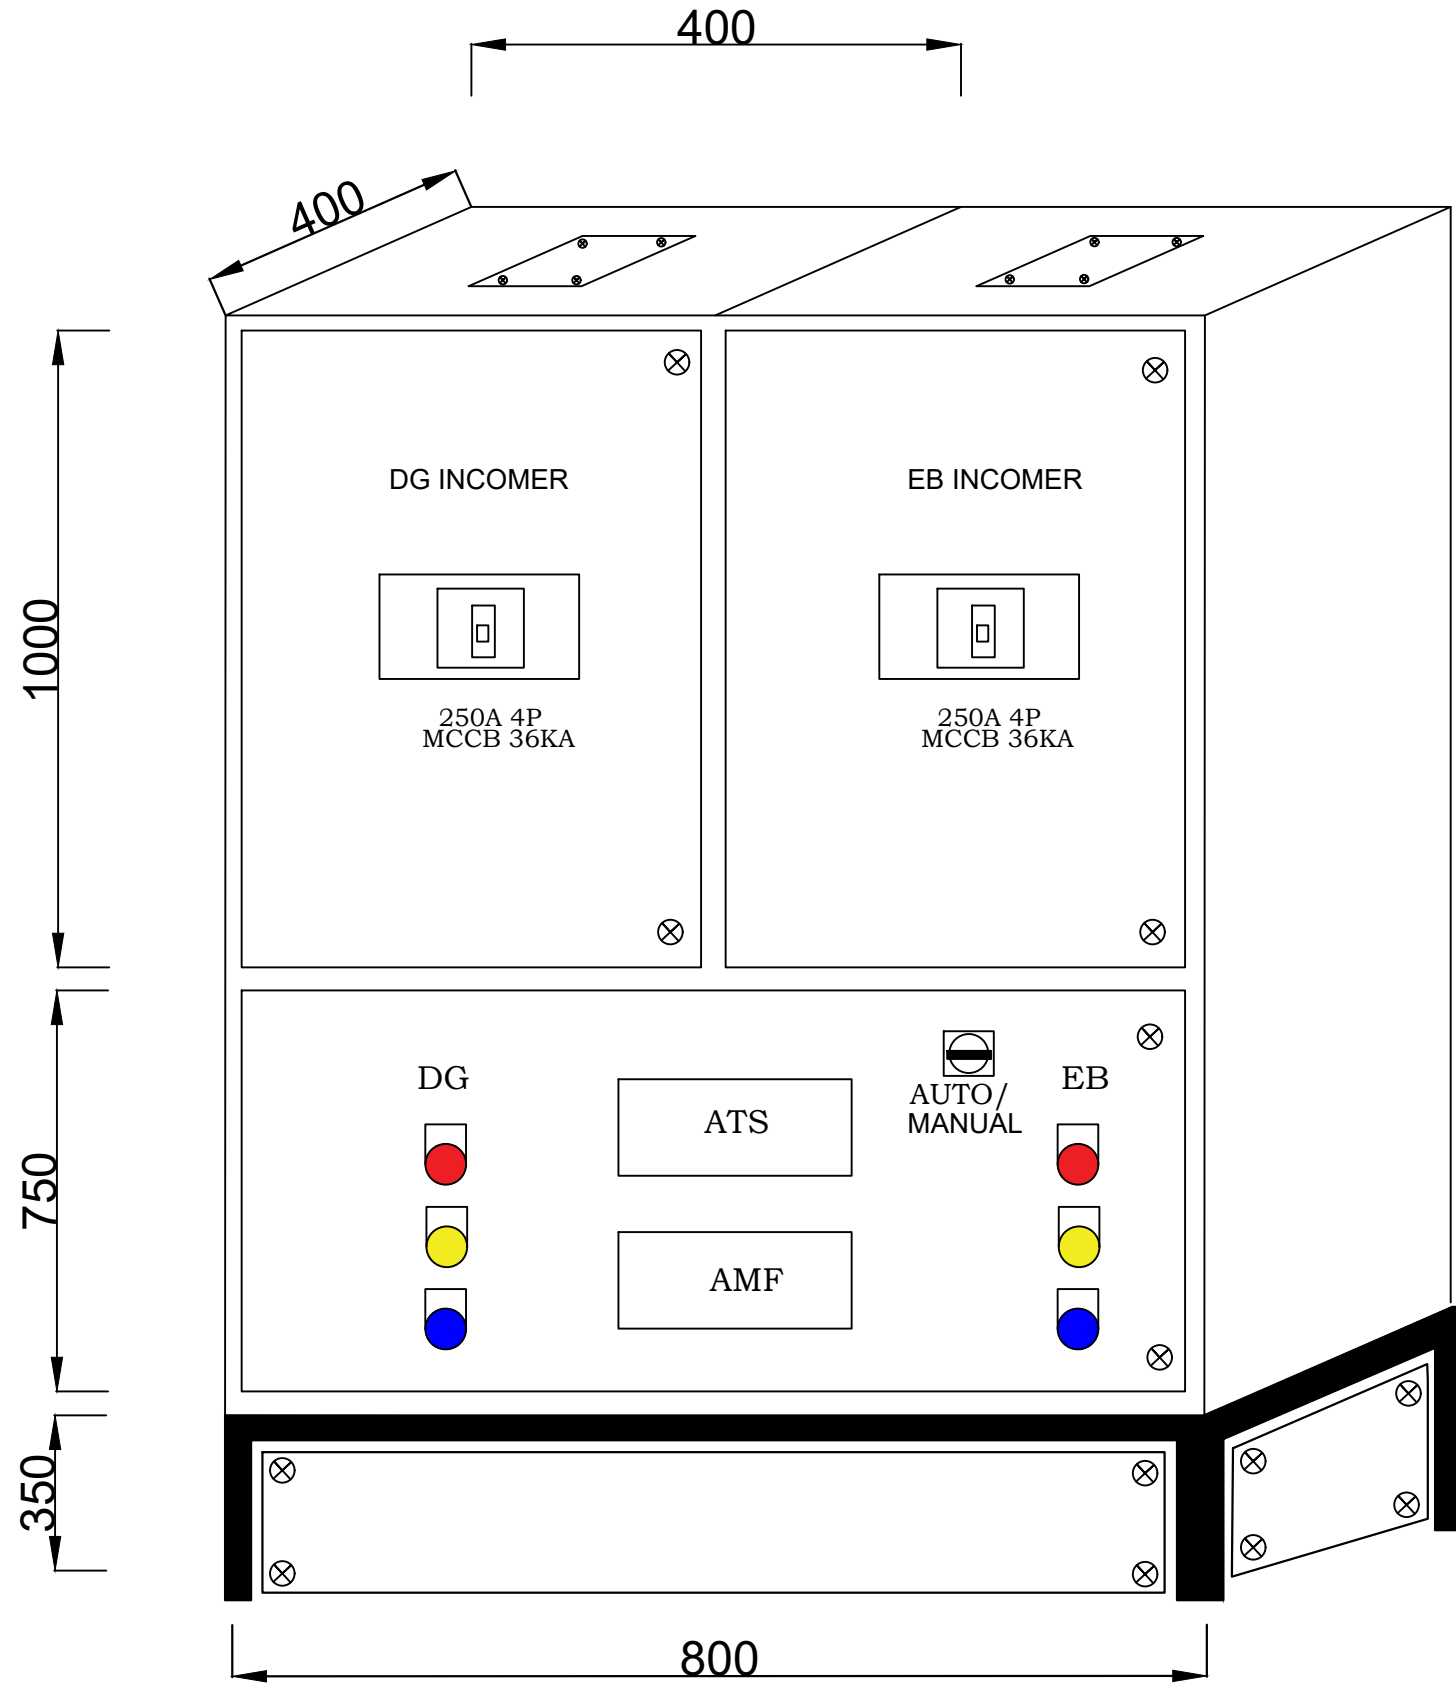

For Electrical Inspectorate:

Signature of Client :

Signature of Contractor :

Signature of Supervisor:

Client:

Contractor:

Site: CSEZ ADMIN BUILDING

Consultnt:



WAPCOS LIMITED
 (एनएलके अन्तर्गत एक संस्था)
 एनएलके अन्तर्गत संस्था
 (A Government of India Undertaking)
 Ministry of Jal Shakti

TITLE:-

DG AMF PANEL
 PANEL DRAWING

DATE	DRAWN	CHECKED	REV.NO
10.09.2022	ARUN KUMAR.M	RATHEESH KUMARA	0
Dwg. No: 01	Scale : NTS	SHEET .NO:01	Unit : mm